

# Air Monitoring Summary Tables

The table below summarizes monitoring data collected using EPA's Viper wireless remote monitoring system.

**Project Name:** H<sub>2</sub>S in South and North Carolina

**From:** 6/13/21  
12:01 AM

**To:** 6/13/21  
11:59 PM



William-Lytle Place							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 1	H2S	No	27159	0	0 - 0 ppb	0 ppb	70 ppb

River Chase							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 2	H2S	No	26865	5136	0 - 11 ppb	0.62 ppb	70 ppb

Millstone Creek							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 3	H2S	No	25995	0	0 - 0 ppb	0 ppb	70 ppb

Sun City							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 4	H2S	No	26974	5038	0 - 18 ppb	0.77 ppb	70 ppb

Bridgemill							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 5	H2S	No	27557	0	0 - 0 ppb	0 ppb	70 ppb

Tom Steven Rd							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 6	H2S	No	27384	0	0 - 0 ppb	0 ppb	70 ppb

Sturgis Rd							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 7	H2S	No	26592	0	0 - 0 ppb	0 ppb	70 ppb

Marvin							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 8	H2S	No	26837	0	0 - 0 ppb	0 ppb	70 ppb


Treetop							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 9	H2S	No	27255	0	0 - 0 ppb	0 ppb	70 ppb

Liberty Hill							
Instrument	Analyte	ATSDR MRL Exceedance?	Number of Readings	Number of Detections	Concentration Range	Period Average	ATSDR MRL
SPM Flex 10	H2S	No	27524	2569	0 - 10 ppb	0.41 ppb	70 ppb

**Notes:**

Hydrogen sulfide concentrations presented in this data summary table are converted from parts per million, the instrument readout units, to parts per billion.


- ATSDR MRL Agency for Toxic Substances and Disease Registry Minimal Risk Level - Acute Exposure (<14 days)
- H<sub>2</sub>S Hydrogen Sulfide
- hr Hour
- ppb Parts per billion
- MRL Exceedance Defines if the 24-hr TWA exceeded the MRL at any time during the period of this report
- SPM Single Point Monitor
- TWA Time Weighted Average

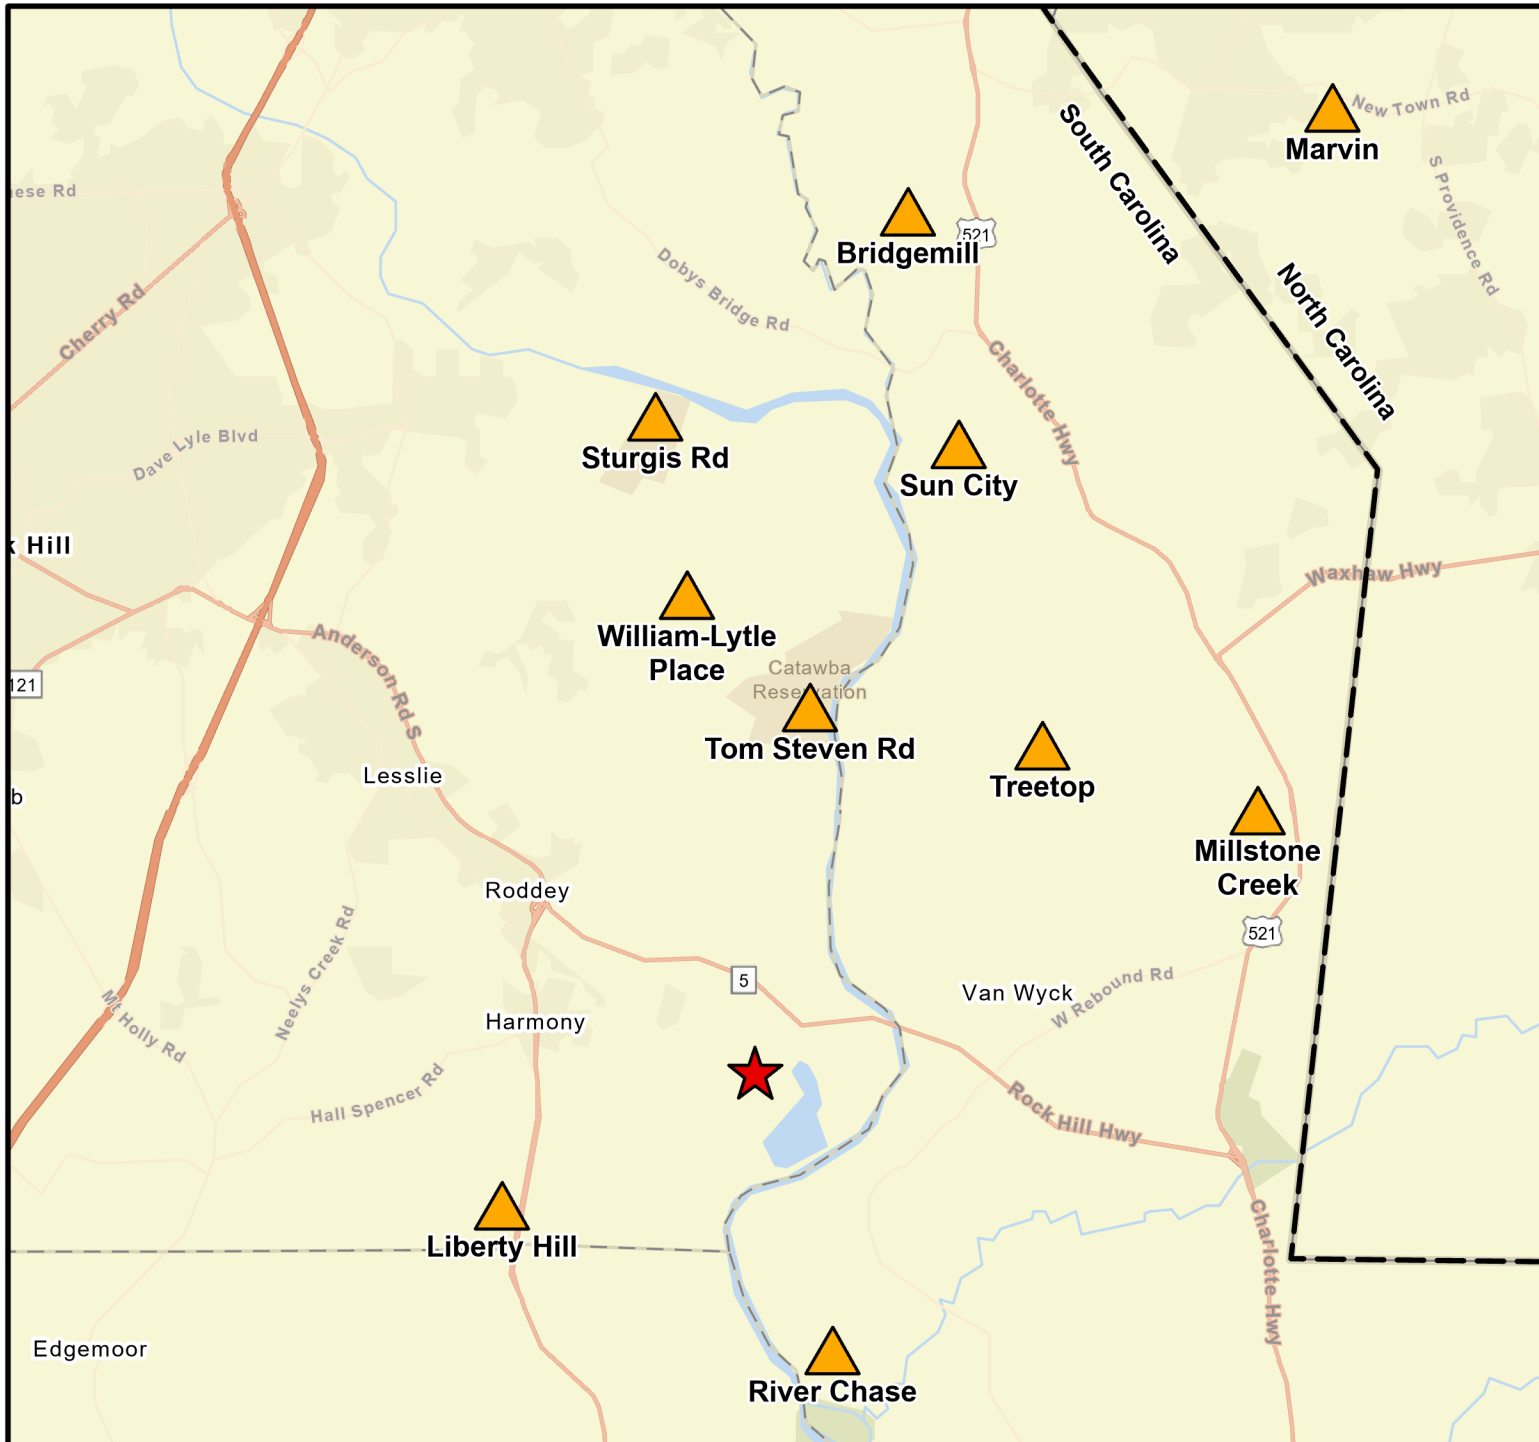

### Legend

- Fixed Monitoring Locations
- New Indy Containerboard

Map Source:  
ESRI Streets

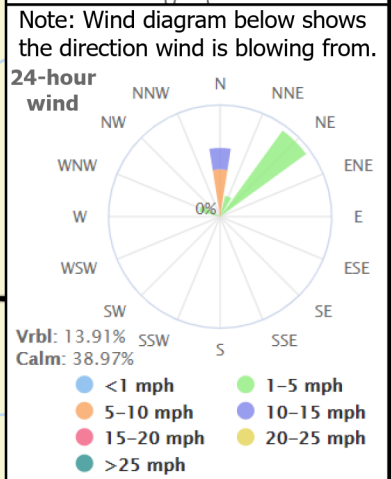


# H<sub>2</sub>S in South and North Carolina

## Hydrogen Sulfide 15-min and 24-hr Time Weighted Graphs

Only locations where hydrogen sulfide was detected during the current reporting period are graphed below.


The prevailing wind directions for this reporting period were out of the northeast and north with a smaller percentage out of the north-northeast. See wind rose diagram on location figure for full wind data during this reporting period.

The following locations did not detect hydrogen sulfide above 1 part per billion: William-Lytle Place, Millstone Creek, Bridgemill, Tom Steven Rd, Sturgis Rd, Marvin, and Treetop.

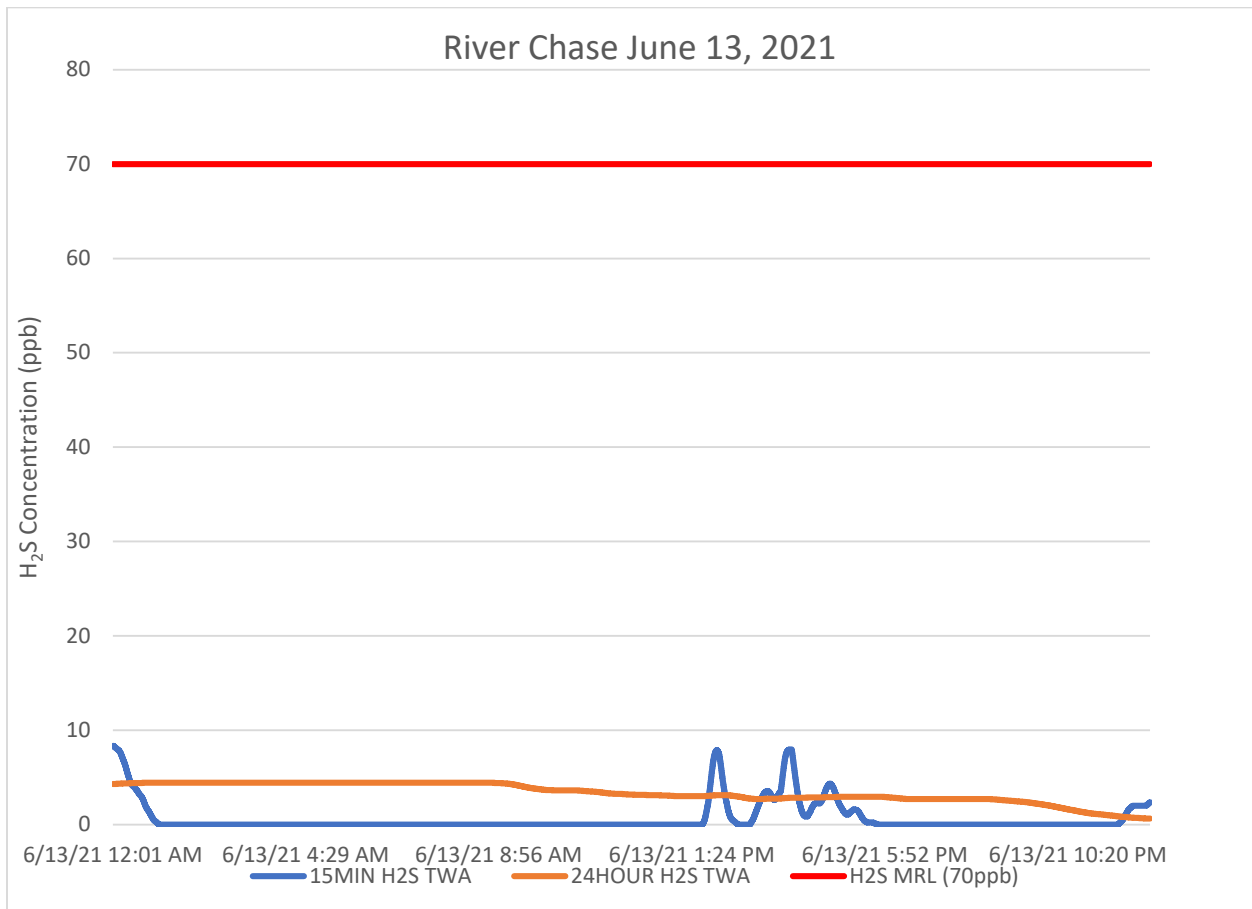


### Notes:

- H<sub>2</sub>S – Hydrogen Sulfide
- MIN – Minute
- MRL – Minimal Risk Level
- ppb – Parts per billion
- TWA – Time weighted average

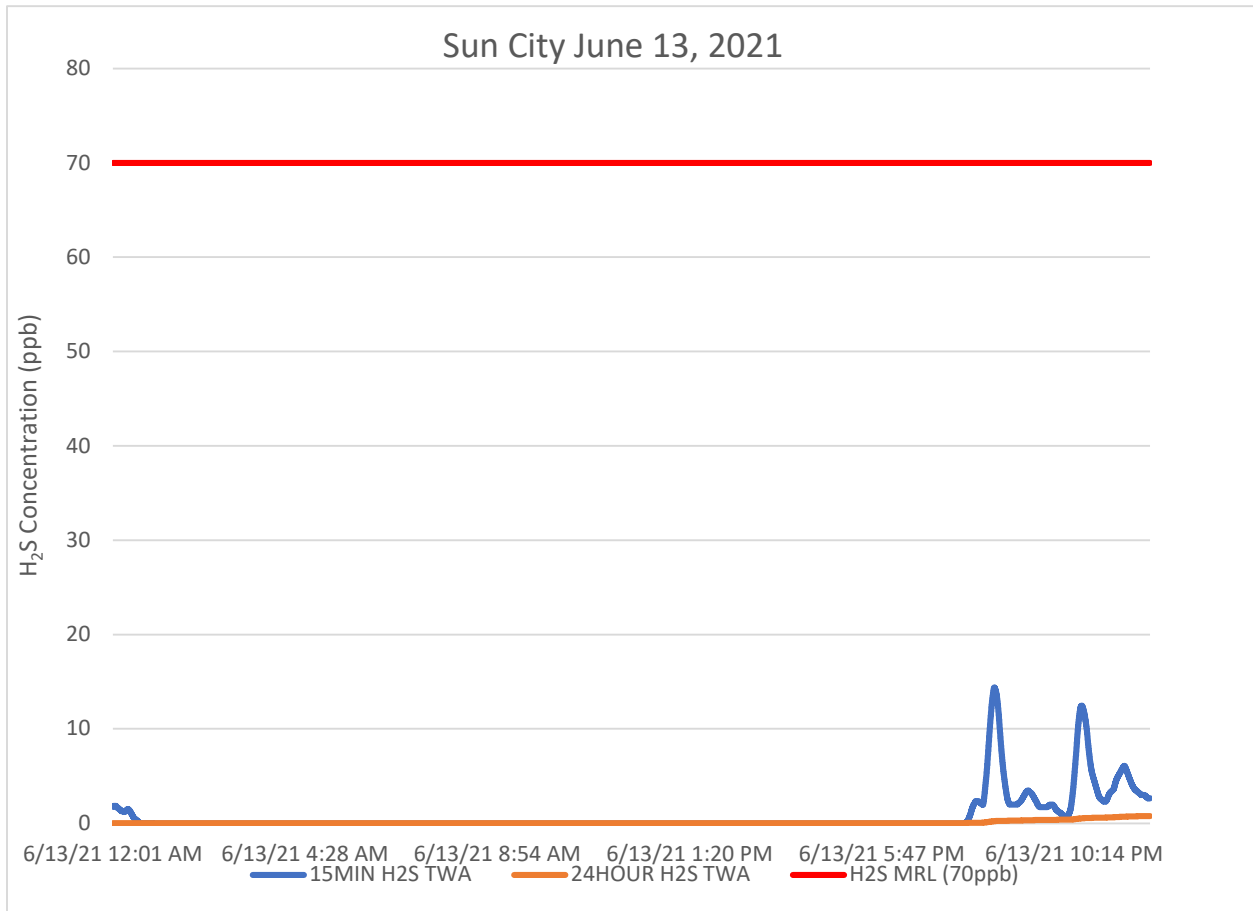

**Notes:**

- H<sub>2</sub>S – Hydrogen Sulfide
- MIN – Minute
- MRL – Minimal Risk Level
- ppb – Parts per billion
- TWA – Time weighted average

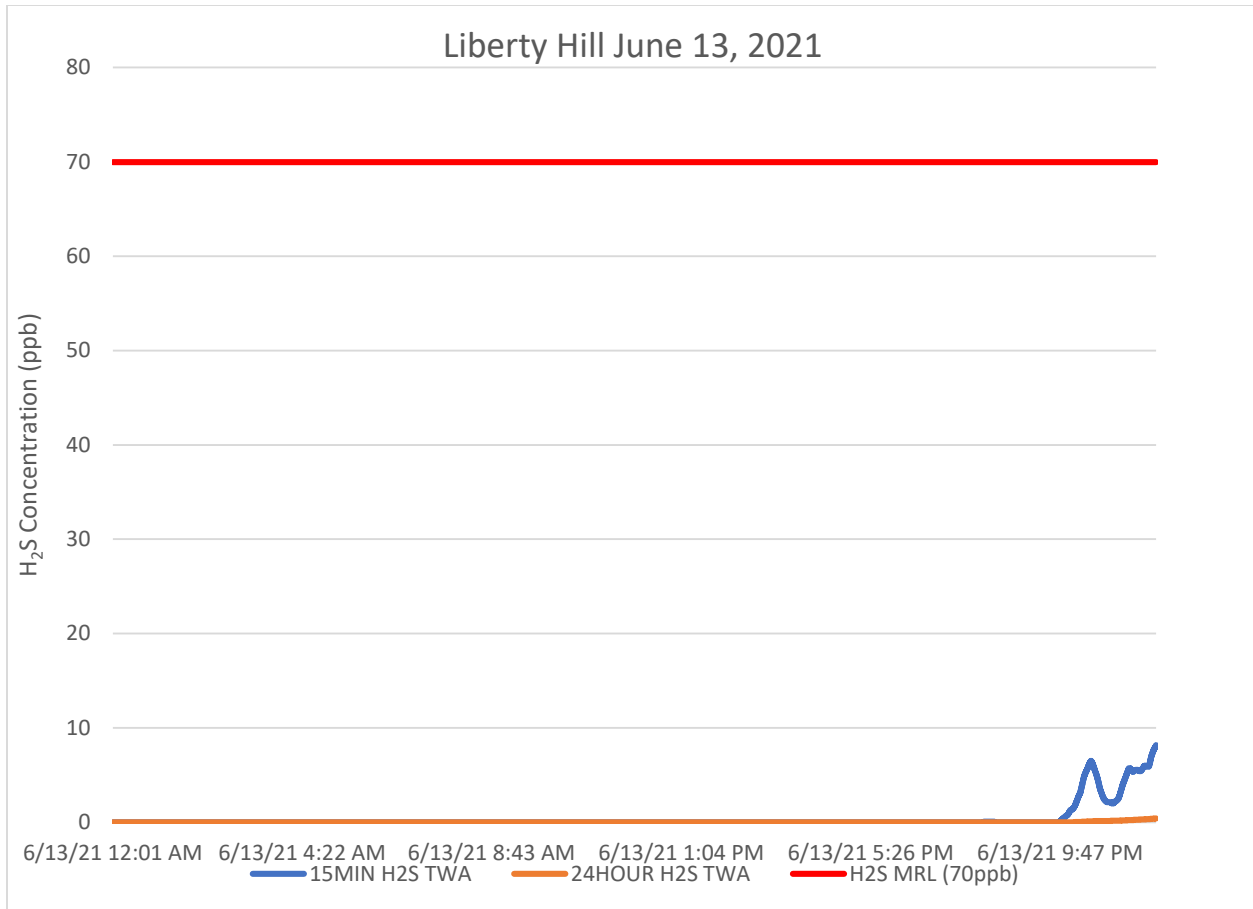

**Notes:**

- H<sub>2</sub>S – Hydrogen Sulfide
- MIN – Minute
- MRL – Minimal Risk Level
- ppb – Parts per billion
- TWA – Time weighted average